

Unit Certificate / Einheitenzertifikat



Certificate holder / Inhaber des Zertifikats

EcoFlow Inc.

RM 401, Plant #1, Runheng Industrial Zone, Fuyuan Road,
Zhancheng Community, Fuhai Street, Bao'an District, Shenzhen,
Guangdong, China

Date of Original Issue / Datum der ursprünglichen Ausgabe

: 2024-11-15

Date of Last Revision / Datum der letzten Überarbeitung

: --

Date of Expiry / Verfallsdatum

: 2027-11-14

Certificate number / Zertifikatsnummer

: PCS-24-1166



Brand / Trademark / Warenzeichen

:



or

ECOFLOW

It is certified that the product / Es ist zertifiziert, dass das Produkt

Models / Modelle

: See appendix on page 3

Type of generator / Generatortyp

: EcoFlow PowerOcean Plus Hybrid Inverter

Technical Data / Technische Daten

: See appendix on page 3

Test Laboratory / Testlabor

: SGS-CSTC Standards Technical Services Co., Ltd. Suzhou
Branch

Test Report (s) / Testbericht(e)

: SUEE241000011051

Test Standard(s) / Prüfnorm(en)

: VDE-AR-N 4105:2018-11 + Correction 1:2020

Is in compliance with the Network connection rule / In Übereinstimmung mit der Anwendungsregel:

VDE-AR-N-4105:2018-11 + Correction 1:2020-10 "Generators connected to the low-voltage distribution network /

Erzeugungsanlagen am Niederspannungsnetz Technical minimum requirements for connection and parallel operation of power generation systems connected to the low-voltage network / *Technische Mindestanforderungen für Anschluss und Parallelbetrieb von Erzeugungsanlagen am Niederspannungsnetz*

Based on tests requirements defined in / Basierend auf Tests Anforderungen definiert in:

VDE V 0124-100: 2020-06 "Network integration of power generation systems – Low voltage / Netzintegration von

Erzeugungsanlagen Test requirements for power generation units intended for connection to and parallel operation on the low-voltage network / *Niederspannung – Prüfanforderungen an Erzeugungseinheiten, vorgesehen zum Anschluss und Parallelbetrieb am Niederspannungsnetz*

This is to certify that the product has been tested and was found to comply with the requirements of the standard(s). / Hiermit wird bescheinigt, dass das Produkt getestet wurde und den Anforderungen der Norm(en) entspricht.

The above-mentioned product is certified according to the requirements of ISO/IEC 17065:2012. / Das oben genannte Produkt ist gemäß den Anforderungen der ISO/IEC 17065:2012 zertifiziert.

Christopher Hee

Certification Officer

SGS Testing & Control Services Singapore Pte Ltd
30 Boon Lay Way #03-01 Singapore 609957



PD-2016-15




The use of this Certificate is subjected to the General Conditions for Certification Services accessible at <https://www.sgs.com/en/terms-and-conditions> and Certification Agreement for SGS Product Certification Scheme (PCS). Any unauthorised alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. This Certificate is part of a full report and should be read in conjunction with it. This Certificate cannot be reproduced except in full, without prior approval of the Company. This Certificate remains the property of SGS Testing & Control Services Singapore Pte Ltd and shall be returned upon request.

APPENDIX(ANHANG)

Certificate number / Zertifikatsnummer: PCS-24-1166

E.5 Requirements for the test report for power generation units E.5 Prüfbericht „Netrückwirkungen“ für Erzeugungseinheiten mit einem Eingangsstrom > 75 A (*)															
Extract from test report for unit certificate "Determination of electrical properties" Auszug aus dem Prüfbericht für Erzeugungseinheiten Bestimmung der elektrischen Eigenschaften"										No. SUEE241000011051					
System Manufacturer Anlagenhersteller:				EcoFlow Inc.											
Manufacturer indications: Herstellerangaben:				Type of system: Anlagenart:			EcoFlow PowerOcean Plus Hybrid Inverter								
				Max. active power PEmax max. Wirkleistung PEmax			EF HD-P3-29K9-S1								
							29900 W								
				Rated voltage: Bemessungsspannung			3L/N/PE, 230 Vac								
Measuring period: 2024-08-21 to 2024-10-23															
Flicker		Network impedance angle ψk Netzimpedanzwinkel ψk					32°								
		Initial flicker factor Cψ Anlagenflickerbeiwert Cψ					33%Pn			66%Pn		100%Pn			
							A	B	C	A	B	C	A	B	C
							0.76	0.62	0.50	0.68	0.56	0.48	0.78	0.62	0.52
Model: EF HD-P3-29K9-S1															
Active power P/Pn [%] Wirkleistung P/Pn [%]	0	10	20	30	40	50	60	70	80	90	100				
Ordinal number Ordnungszahl	I(%)	I(%)	I(%)	I(%)	I(%)	I(%)	I(%)	I(%)	I(%)	I(%)	I(%)				
Harmonics Phase A Oberschwingungen															
2	0.133	0.096	0.042	0.040	0.047	0.057	0.067	0.087	0.102	0.128	0.209				
3	0.589	0.597	0.648	0.608	0.604	0.592	0.617	0.633	0.638	0.623	1.264				
4	0.205	0.128	0.100	0.125	0.159	0.188	0.203	0.210	0.228	0.240	0.276				
...															
40	0.048	0.042	0.008	0.017	0.008	0.007	0.019	0.027	0.029	0.022	0.023				
Harmonics Phase B Oberschwingungen															
2	0.115	0.037	0.037	0.052	0.042	0.032	0.048	0.040	0.041	0.060	0.084				
3	0.612	0.514	0.420	0.395	0.370	0.373	0.357	0.343	0.330	0.316	1.018				
4	0.249	0.106	0.114	0.157	0.172	0.233	0.246	0.254	0.269	0.260	0.264				
...															
40	0.047	0.043	0.030	0.033	0.031	0.038	0.052	0.061	0.059	0.046	0.056				
Harmonics Phase C Oberschwingungen															
2	0.102	0.072	0.059	0.052	0.068	0.067	0.082	0.090	0.100	0.122	0.213				
3	1.176	1.097	1.083	1.017	0.977	0.948	0.946	0.940	0.931	0.903	2.085				
4	0.053	0.047	0.065	0.118	0.125	0.155	0.151	0.141	0.138	0.130	0.213				
...															
40	0.029	0.039	0.027	0.019	0.027	0.037	0.034	0.036	0.038	0.030	0.035				

(*) the inverter outputs a current <75 A, thus Inter-harmonics and High Frequencies are not evaluated in accordance with the standard.

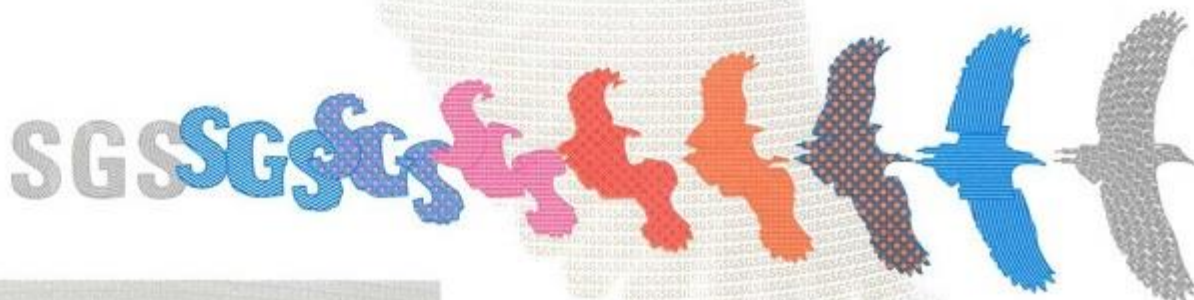

The use of this Certificate is subjected to the General Conditions for Certification Services accessible at <https://www.sgs.com/en/terms-and-conditions> and Certification Agreement for SGS Product Certification Scheme (PCS). Any unauthorised alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. This Certificate is part of a full report and should be read in conjunction with it. This Certificate cannot be reproduced except in full, without prior approval of the Company. This Certificate remains the property of SGS Testing & Control Services Singapore Pte Ltd and shall be returned upon request.

APPENDIX(ANHANG)

Certificate number / Zertifikatsnummer: PCS-24-1166

Full list of product references and nominal characteristics / Vollständige Liste der Produktreferenzen und nominalen Merkmale:

Rating specifications of EcoFlow PowerOcean Plus Hybrid Inverter				
Model	EF HD-P3-29K9-S1	EF HD-P3-25K0-S1	EF HD-P3-20K0-S1	EF HD-P3-15K0-S1
Input:				
Vmax PV (Vdc)	1000			
Start-up Voltage (Vdc)	160			
MPPT Voltage Range (Vdc)	200-850			
Isc PV (absolute Max.) (A)	PV1 19/19, PV2/3 24/24			
Number of MPP trackers	3			
Max. PV input current (A)	PV1 16/16, PV2/3 16/16			
Battery (charge / discharge):				
Battery Nominal Voltage (V)	800			
Max Battery Voltage (V)	960			
Max. Current (A)	40.0	33.3	26.6	20.0
AC Input (Grid Side):				
Normal AC Voltage (Vac)	400/230, 3L/N/PE			
Frequency (Hz)	50			
Max. input current (A)	63.0			
Power factor(adjustable)	-0.8 ~ +0.8			
AC Output (Grid Side)				
Normal AC Voltage (Vac)	400/230, 3L/N/PE			
Frequency (Hz)	50			
Rated output Current (A)	43.3	36.2	29.0	21.7
Rated apparent output Power (VA)	29900	25000	20000	15000
Max. apparent output Power (VA)	29900	25000	20000	15000
Power factor(adjustable)	-0.8 ~ +0.8			
AC Output (Back-up):				
Normal Voltage (Vac)	3L/N/PE 400/230			
Frequency (Hz)	50			
Rated output Current (A)	43.3	36.2	29.0	21.7
Max. output Current (Off-Grid) (A)	52.0@1s	43.4@1s	34.8@1s	26.0@1s
Normal apparent output Power (VA)	29900	25000	20000	15000
Max. apparent output Power (VA)	35880@1s	30000@1s	24000@1s	18000@1s
Others:				
Ingress protection (IP)	IP65			
Protective class	Class I			
Temperature (°C)	-20°C to +50°C			
Cooling Method	Intelligent air cooling			
Inverter Isolation	Non-isolated			
Overvoltage category	II (PV), III (Mains)			
Dimensions (W*D*H)	636*235*498mm (without trim cover)			
Weight	41.0 kg			
Altitude	3000m			
Topology	Transformerless			



The use of this Certificate is subjected to the General Conditions for Certification Services accessible at <https://www.sgs.com/en/terms-and-conditions> and Certification Agreement for SGS Product Certification Scheme (PCS). Any unauthorised alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. This Certificate is part of a full report and should be read in conjunction with it. This Certificate cannot be reproduced except in full, without prior approval of the Company. This Certificate remains the property of SGS Testing & Control Services Singapore Pte Ltd and shall be returned upon request.